


KERB TYPE C01

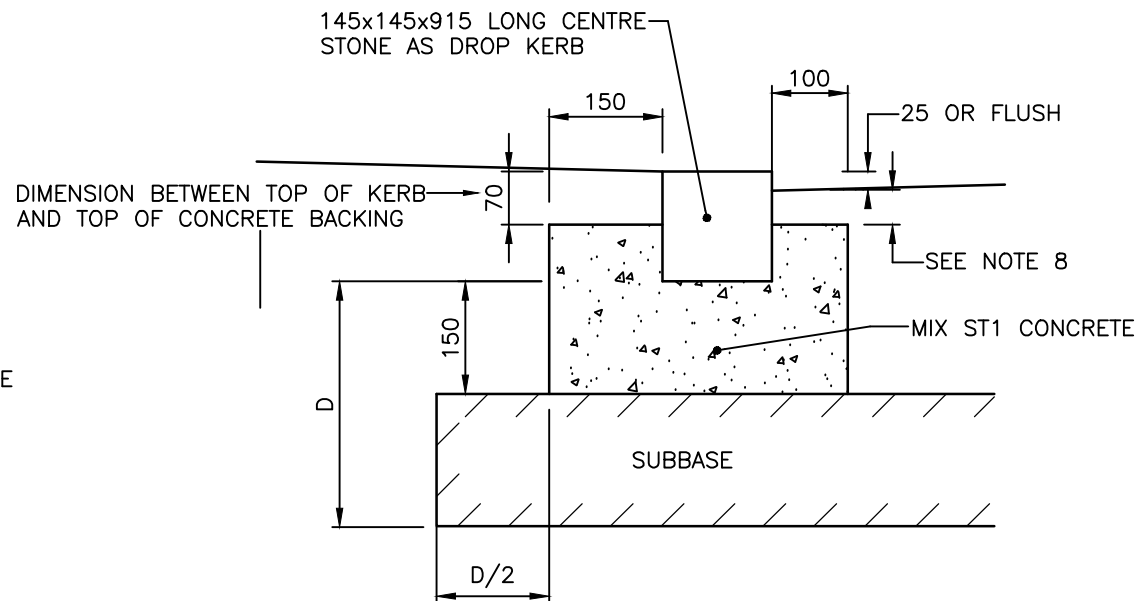

KERB TYPE C02 (25 UPSTAND)
KERB TYPE C03 (FLUSH)

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. KERBS SHALL BE MARSHALL'S SILVER GREY 'CONSERVATION' KERB OR EQUIVALENT.
3. MIX ST1 CONCRETE KERB BEDDING SHALL LAID ON SUBBASE AND SHALL BE A MINIMUM THICKNESS OF 150. SUBBASE SHALL BE EXCAVATED WHERE NECESSARY TO ACHIEVE 150 THICKNESS OF CONCRETE. RECOMPACT DISTURBED SUBBASE PRIOR TO CONSTRUCTION OF KERB BASE.
4. AS DESCRIBED IN CLAUSE 1101, SUB-CLAUSE 1, KERBS MAY BE LAID AND BEDDED ON MORTAR IN ACCORDANCE WITH CLAUSE 2601 OR LAID DIRECTLY ONTO THE CONCRETE BED. THE TYPE OF MORTAR SHALL BE APPROVED BY THE OVERSEEING ORGANISATION.
5. THE APPROPRIATE 914 LONG DROPPER KERB SHALL BE INSTALLED AT EACH CHANGE IN KERB TYPE, TIE-INS TO EXISTING AND AT TERMINATIONS.
6. THE MINIMUM LENGTH OF ANY CUT KERB SHALL BE 450.
7. THE KERB UPSTAND FOR TYPE C01 SHALL BE 100 UNLESS OTHERWISE STATED, EXCEPT OVER BRIDGES WHERE IT SHALL BE AS SHOWN ON THE SCHEME DRAWINGS.
8. DEPTH OF SURFACE COURSE OVER KERB BED TO BE AS SPECIFIED FOR ADJACENT SURFACE COURSE (MINIMUM 40).

REV	AMENDMENTS	DATE	CAD	CHKD	APPD

CONSULTANT



STUART JARVIS BSc DipTP FCIHT MRTPI: DIRECTOR OF ECONOMY, TRANSPORT & ENVIRONMENT

SCHEME

STANDARD DETAILS

DRAWING TITLE

CONSERVATION KERBS

HCC CADplot: 24.Mar.2020 at 9:23am		
DRAWN	CHECKED	SCALE @ A3
MC	JPR <i>JPR</i>	N.T.S
CAD	APPROVED	DATE
MC	CDP <i>CDP</i>	March 2020
DRG No.	REVISION	
HCC11/C/025		

Copyright Hampshire County Council. 2015

All rights, including translation, reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means (electronic, mechanical, photocopied, recorded or otherwise) without the prior written permission of Hampshire County Council. Requests should be directed to the Economy, Transport & Environment Department.

HCC CADfile: K:\Eng\Standard\AutoCAD\Standard Details (Secure) As Updated Dec 2011\HCC11 2020 STANDARD DETAILS\C-025.dwg