


**SINGLE PHASE
DOUBLE POLE**

TYPE NT06 LOOP IN/OUT
SINGLE FUSE


TYPE 1

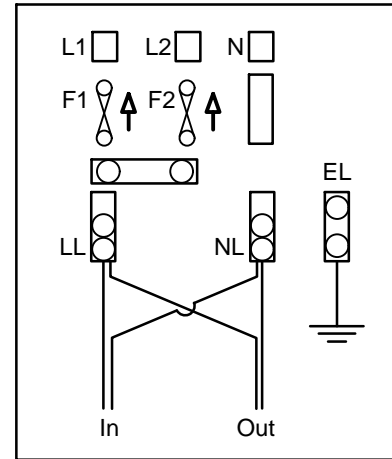

**SINGLE PHASE
DOUBLE POLE**

TYPE NT08 LOOP IN/OUT
TWO FUSES

TYPE 2

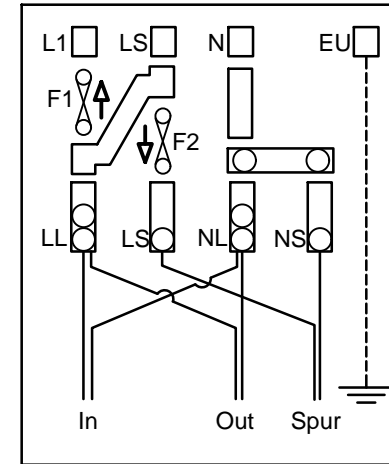


**SINGLE PHASE DOUBLE POLE
WITH DOUBLE FUSED SPUR**

TYPE NT10 LOOP IN/OUT WITH
FUSED DOUBLE POLE SPUR

TYPE 3

NOTES

1. S.W.A. TERMINATIONS ARE REQUIRED AND SHALL BE CONNECTED TOGETHER AND TO THE COLUMN OR ILLUMINATED SIGN POST EARTH STUD BY 6mm² CU. CIRCUIT PROTECTIVE CONDUCTOR.
2. ALL CUT OUTS SHALL HAVE H.R.C. FUSE IN PULL OUT CARRIER AND PROVISION FOR LIVE, NEUTRAL AND EARTH CABLE CONNECTIONS INCLUDING A P.M.E. LINK.
3. ALL CUT OUTS SHALL BE DRIP PROOF.
4. MAXIMUM CABLE ENTRY 3X35mm² 2c CU. CABLES.
5. ALL FIXING SCREWS, NUTS ETC. TO BE STAINLESS STEEL.
6. FOR METHOD OF EARTHING XLPE/SWA/XLPE CABLES SEE DRAWING NUMBER HCC11/L/060.
7. TYPE 6, CORRECT FUSE DISCRIMINATION MUST BE ENSURED FOR EACH APPLICATION.
8. ISOLATORS SHALL COMPLY WITH THE CURRENT EDITION OF BS EN 60947.
9. EACH CABLE SHALL BE PROVIDED WITH A DURABLE LABEL INDICATING PHASE AND LOCATION OF ORIGIN.



B	COPYRIGHT AMENDED AND NEW DIRECTORATE DETAILED.	06.02.2023	AM	JH	JH
A	BRANDING UPDATED.	15.07.2022	CLT	IH	JH
REV	AMENDMENTS	DATE	CAD	CHKD	APPD

CONSULTANT

TIM LAWTON BEng CEng FICE FCIHT : ASSISTANT DIRECTOR OF UNIVERSAL SERVICES

SCHEME

STANDARD DETAILS

DRAWING TITLE

**TERMINATION OF (S.W.A)
CABLES IN COLUMNS
OR POSTS FOR A
PRIVATE NETWORK**

DESIGNER	CHECKED	SCALE @ A3
WW	IH IH	N.T.S
CAD	APPROVED	DATE
WW	JH JH	March 2020
DRAWING NUMBER	REV	
HCC11/L/045	B	

Copyright Hampshire County Council.

All rights, including translation, reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means (electronic, mechanical, photocopied, recorded or otherwise) without the prior written permission of Hampshire County Council. Requests should be directed to Hampshire Engineering Services.