


SINGLE PHASE DOUBLE POLE

TYPE NT06 LOOP IN/OUT
SINGLE FUSE


TYPE 1

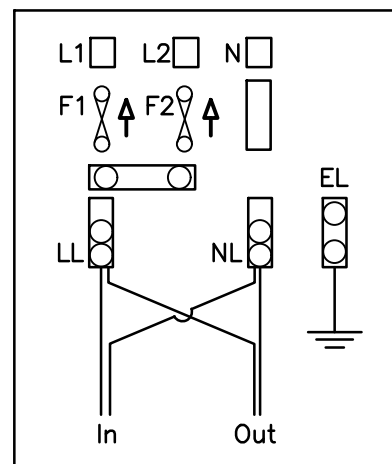

SINGLE PHASE DOUBLE POLE

TYPE NT08 LOOP IN/OUT
TWO FUSES

TYPE 2

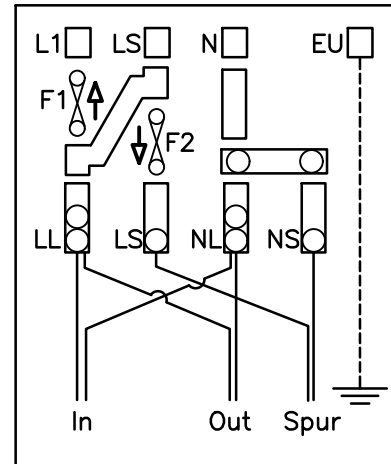

SINGLE PHASE DOUBLE POLE
WITH DOUBLE FUSED SPUR

TYPE NT10 LOOP IN/OUT WITH
FUSED DOUBLE POLE SPUR

TYPE 3

NOTES:

1. S.W.A. TERMINATIONS ARE REQUIRED AND SHALL BE CONNECTED TOGETHER AND TO THE COLUMN OR ILLUMINATED SIGN POST EARTH STUD BY 6mm² CU. CIRCUIT PROTECTIVE CONDUCTOR.
2. ALL CUT OUTS SHALL HAVE H.R.C. FUSE IN PULL OUT CARRIER AND PROVISION FOR LIVE, NEUTRAL AND EARTH CABLE CONNECTIONS INCLUDING A P.M.E. LINK.
3. ALL CUT OUTS SHALL BE DRIP PROOF.
4. MAXIMUM CABLE ENTRY 3X35mm² 2c CU. CABLES.
5. ALL FIXING SCREWS, NUTS ETC. TO BE STAINLESS STEEL.
6. FOR METHOD OF EARTHING XLPE/SWA/XLPE CABLES SEE DRAWING NUMBER HCC11/L/060.
7. TYPE 6, CORRECT FUSE DISCRIMINATION MUST BE ENSURED FOR EACH APPLICATION.
8. ISOLATORS SHALL COMPLY WITH THE CURRENT EDITION OF BS EN 60947.
9. EACH CABLE SHALL BE PROVIDED WITH A DURABLE LABEL INDICATING PHASE AND LOCATION OF ORIGIN.

REV	AMENDMENTS	DATE	CAD	CHKD	APPD

CONSULTANT

STUART JARVIS BSc DipTP FCIHT MRTPI: DIRECTOR OF ECONOMY, TRANSPORT & ENVIRONMENT

SCHEME

STANDARD DETAILS

DRAWING TITLE

**TERMINATION OF (S.W.A)
CABLES IN COLUMNS
OR POSTS FOR A
PRIVATE NETWORK**

HCC CADplot: 25.Feb.2020 at 9:31pm					
DRAWN	WW	CHECKED	IH, I, H	SCALE @ A3	N.T.S
CAD	WW	APPROVED	JH, JH	DATE	March 2020
DRG No.	HCC11/L/045				REVISION

Copyright Hampshire County Council. 2019

All rights, including translation, reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means (electronic, mechanical, photocopied, recorded or otherwise) without the prior written permission of Hampshire County Council. Requests should be directed to the Economy, Transport & Environment Department.

Use only for Standard AutoCAD Standard Details (Secure) As Issued on Dec 2014\HCC11 2020 STANDARD DETAILS (Secure) (AME.dwg)